



Saves Your Energy

INSTALLATION INSTRUCTION
PEM1343ENG
2011-07

GENERAL INFORMATION


- Check that the product is suitable for the intended installation.
- Check the materials listed in the bill of materials for completeness.
- Read the installation instructions carefully before starting the installation.
- Install carefully and make sure the materials are clean during the installation.
- Clean the working place after the installation.

LEGAL NOTICE


- The product must be installed only by a competent person with sufficient training in installation practices and with sufficient knowledge of good safety and installation practices in respect of electrical equipment. If local legislation contains provisions in respect of such training or sufficient knowledge in respect of installation of electrical equipment such provisions shall be fulfilled by the said person.
- Ensto accepts no liability concerning claims resulting from misuse, incorrect installation or ignored national safety regulations or other national provisions.
- **WARNING:** Failure to follow the installation instructions may result in damage to the product and serious or fatal injury.

Tension clamp SO118.1201S & SO118.1202S

For the termination of 4-core LV ABC cable with hook fixing. The clamps have strong springs which keep the clamp in an open position during the installation of conductors. The clamping action functions through wedges. The body is made of weather resistant aluminium alloy and the plastic parts of special fibreglass reinforced plastic.




SO118.1201S



SO118.1202S

Type	Conductor size mm ²	Cable diameter mm	Weight (kg)	Pack./pcs
SO118.1201S	4x(50-120)	10.8-16.7	1.20	10
SO118.1202S	4x(50-120)	10.8-16.7	1.38	10

1.

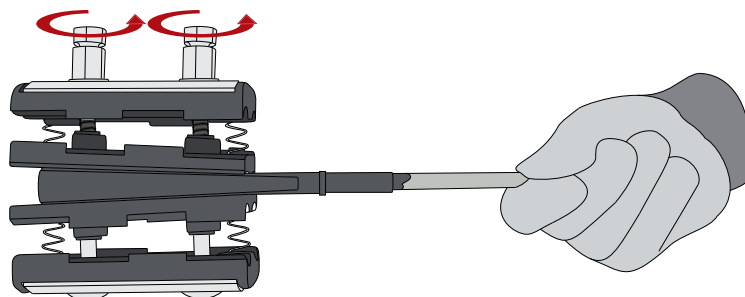




Saves Your Energy

INSTALLATION INSTRUCTION
PEM1343ENG
2011-07


2.

4x(50-120) mm²

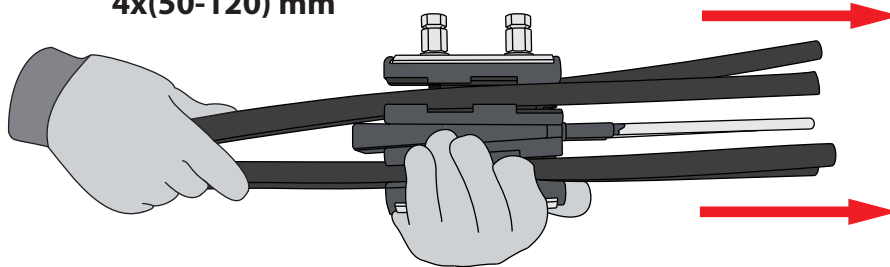

3.

(44 Nm)

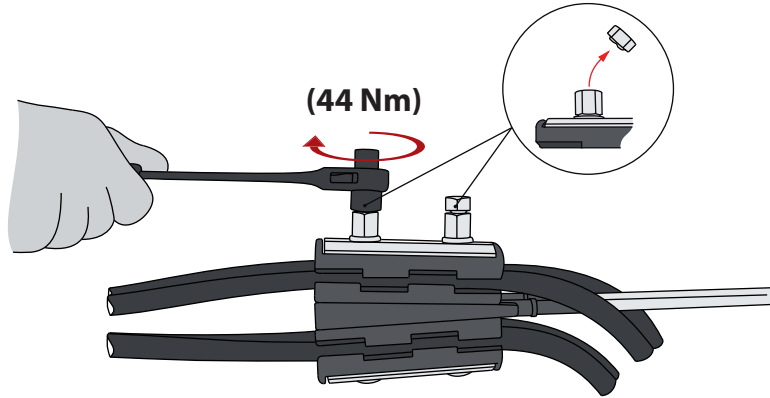

4.

